

Anderson Pump Service Inc.

Shell
300 Dixie Highway
Chicago Heights, IL 60411

RE: Decommissioning of Stage 2 vapor recovery

This letter is to inform you that all tanks and piping from the facility located at 300 S Dixie Highway were replaced on OSFM permit 01081-2016 and no vapor recovery was ever installed on the new system.

This work was done by a contractor who has deceased so the company is no longer in business. I have included copies of the permit and the drawing for the new piping for it.

I certify that we went to the site and there is no Stage 2 vapor recovery piping installed and hasn't been in operation since the tanks and piping were replaced in 2016/2017.



Stephen M Kryl
Anderson Pump Service
Phone 708-478-6190
Fax 708-478-6190
Cell 708-243-9081



Office of the Illinois State Fire Marshal
 Division of Petroleum and Chemical Safety
 1035 Stevenson Drive
 Springfield, IL 62703
 2177851020

FOR OFFICE USE ONLY
 Facility # 2035789
 Permit # 01081-2016INS
 Request Rec'd 08/18/2016
 Amended Date
 Approval Date 8/24/2016 DS
 Permit Expires 2/24/2017

Permit for INSTALLATION of Underground Storage Tank(s) and Piping for Petroleum and Hazardous Substances.

Permission to install underground storage tank(s) or piping is hereby granted. Such installation must be in complete accordance with acceptable materials as specified in the Federal Register, Part II Environmental Protection Agency, 40 CFR Parts 280 and 281, and also with all sections of 41 Illinois Administrative Code, Parts 174, 175 and 176. The contractor the permit was issued to or an employee of that contractor (this does not include a subcontractor) shall submit a required job schedule for installation of underground storage tank(s) to the Office of the State Fire Marshal, Division of Petroleum and Chemical Safety. **THIS PERMIT IS VALID FOR SIX MONTHS FROM THE APPROVAL DATE.**

<p>(1) OWNER OF TANKS - Corporation, partnership, or other business entity:</p> <p>Veer Petro, Inc. 300 Dixie Highway Chicago Heights, IL 60411 Contact: (708) 473-7140</p>	<p>(2) FACILITY - name and address where tanks are located:</p> <p>Veer Petro, Inc. 300 Dixie Highway Chicago Heights, IL 60411 Contact: Sukhdev Singh 7083339798</p>
---	---

(3) INSTALLATION OF TANKS:

- (a) *Number and size of tanks being installed: (TK # 9, 10) - 4,000*
- (b) *Type of tank(s): (TK # 9, 10) Tank - Fiberglass Double Wall Containment Solutions*
- (c) *Type of piping: (TK # 9, 10) Piping - Fiberglass Double Wall Ameron Dualoy 3000/LCX, (TK # 9) Piping - Submersible Sumps Containment Solutions Single Wall Fiberglass, (TK # 9, 10) Piping - Dispenser Sumps A.P.T. Poly Tech Polyethylene LM Series, (TK # 10) Piping - Submersible Sumps Containment Solutions Double Wall Fiberglass*
- (d) *Product to be stored in each tank: (TK # 9) - Gasoline, (TK # 10) - Diesel Fuel*
- (e) *Type of leak detection being used:*
 - Tank: (TK # 9, 10) Leak Detect - Tank - Automatic Tank Gauging Veeder Root TLS 350 with CSLD, (TK # 9, 10) Leak Detect - Tank - Interstitial Monitoring Veeder Root TLS 350*
 - Piping: (TK # 9) Leak Detect - Piping - Mechanical Pressurized Line Leak Detection FE Petro STP-MLD, (TK # 9) Leak Detect - Piping - Piping Sump Sensors Interstitial Monitoring Veeder Root TLS 350, (TK # 9, 10) Leak Detect - Piping - Interstitial Monitoring, (TK # 10) Leak Detect - Piping - Mechanical Pressurized Line Leak Detection FE Petro STP-MLD-D, (TK # 10) Leak Detect - Piping - Piping Sump Sensors Interstitial Monitoring Veeder Root TLS 350 interstitial piping float sensor*
- (f) *Corrosion Protection being used:*
 - Tank: (TK # 9, 10) Corrosion Prot - Tank - Fiberglass Non-Corrosive*
 - Piping: (TK # 9, 10) Corrosion Prot - Piping - Fiberglass Non-Corrosive*
- (g) *Spill containment devices, piping and dispenser containment devices: (TK # 9, 10) Spill Contain Device - Manhole Pre-manufactured OPW 1-2100*
- (h) *Overfill prevention devices: (TK # 9, 10) Overfill Prev Device - Overfill Drop Tube Valve OPW 61SO*

(4) The owner must notify this Office when completion of tank installation has occurred, on the Notification for Underground Storage Tank Form and the licensed contractor must submit the required job schedule for installation to the OSFM prior to the work being performed. Both forms can be obtained at www.sfm.illinois.gov by calling (217)785-1020.

(5) **GENERAL REQUIREMENTS** : There shall be a minimum of two manufactured slotted or perforated observation wells of at least 4 inches in diameter, installed in each new tank field of tanks larger than 1000 gallons and one well for tanks less than 1000 gallons. A water tight containment shall be installed under all dispensers and at submersible pumps. A hydrostatic test must be performed on all containments. All steel piping for vents, risers, and fills in contact with the ground, backfill, or water shall be dielectrically wrapped or coated. A positive shut

Electronic Filing: Received, Clerk's Office 02/14/2023

off valve shall be installed on pressurized product lines, at the submersibles, or installed at the tank for all suction piping systems. Vent piping is required to be tested from tank to grade level. All steel flex connectors in contact with ground, backfill or water shall have corrosion protection.


(6) SPECIAL CONTINGENCIES :

(6) PERSON, FIRM OR COMPANY PERFORMING WORK:

BMPC, Inc.
1510 Spring Bay Road, Unit E
East Peoria, IL 61611


Contact Person: Amanda McCormick
Phone: (309) 208-5264
Contractor Registration # IL002393 Exp. 12/12/2016

Sincerely,



Daniel Starks

cc: Storage Tank Safety Specialist
Division File

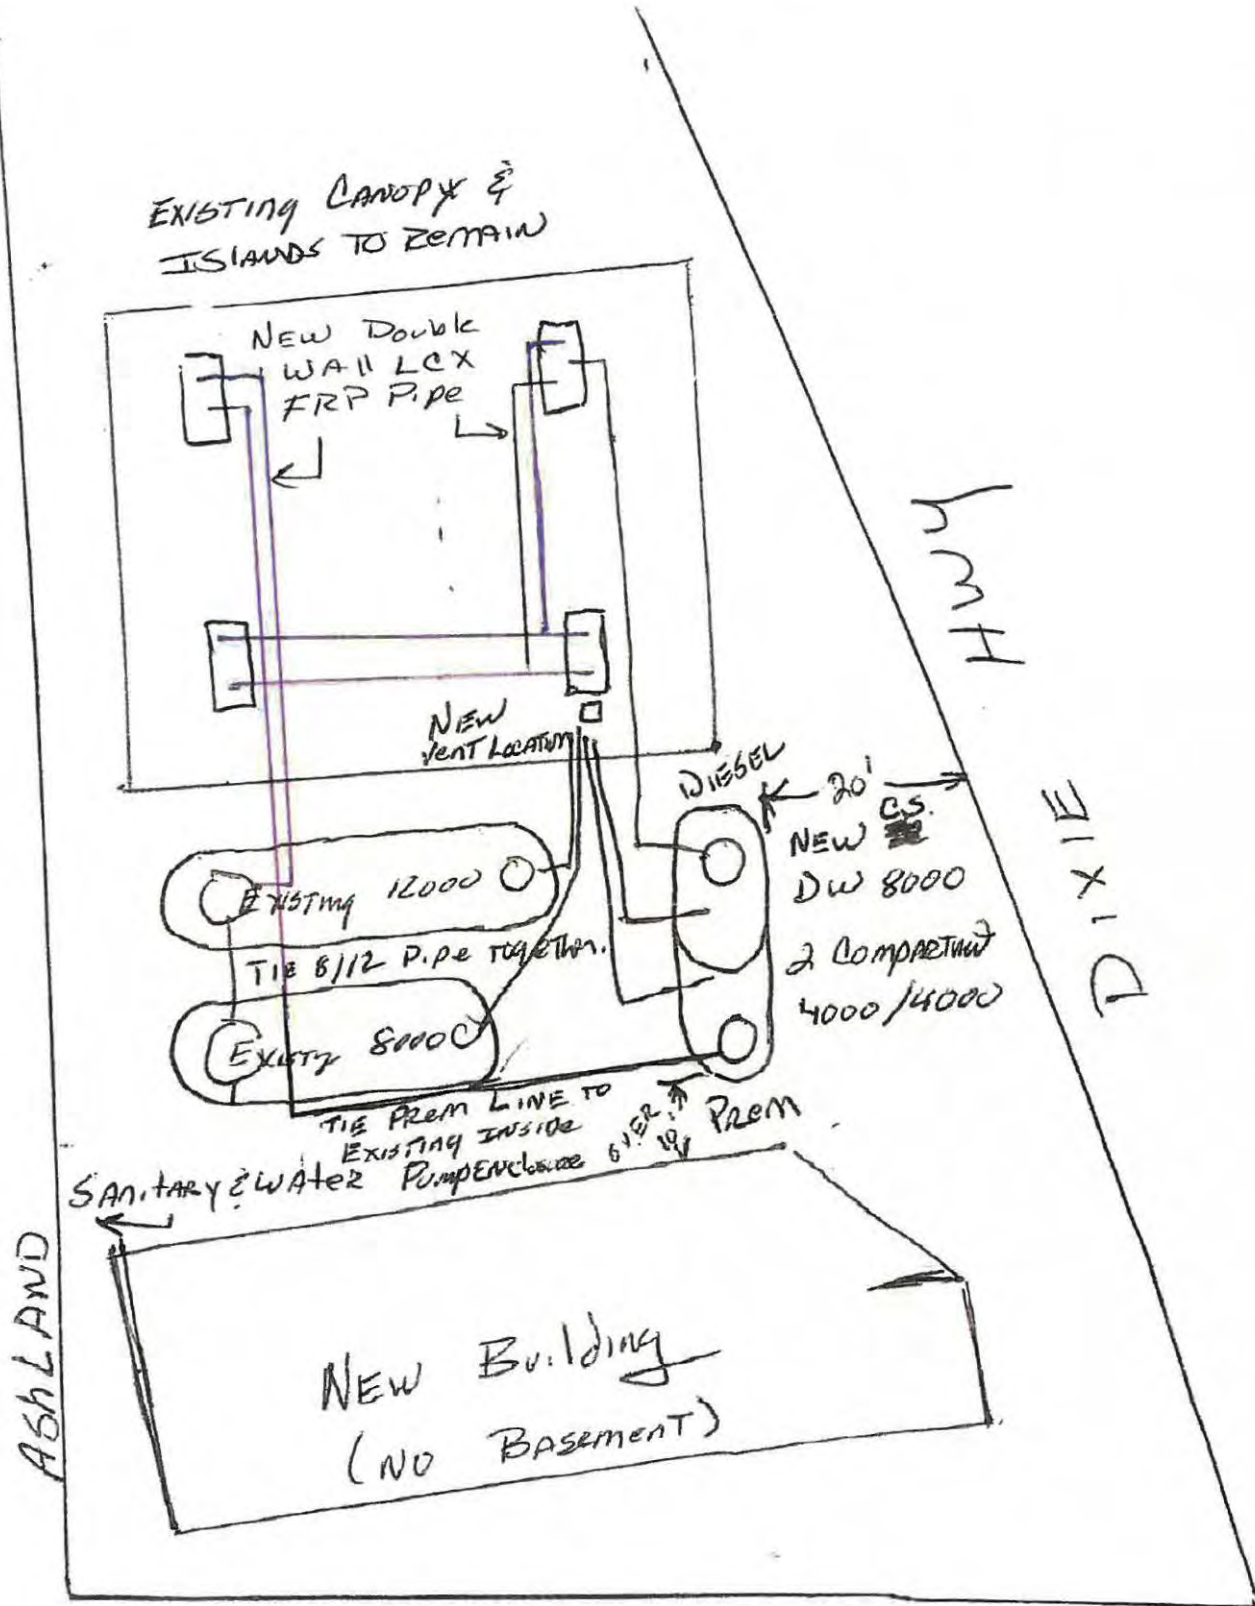

VEEIR PETRO, INC FACILITY # 2035789
300 DIXIE HIGHWAY
CHICAGO HEIGHTS, IL 60411

